



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

- This Level 1 RSMP applies to:
- a facility with a total propane storage capacity of 5,000 USWG or less; or
 - a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

<p style="text-align: center;">Failure to fully complete this form may result in rejection. Making a false statement may result in a fine or prosecution under the <i>Technical Standards and Safety Act</i></p> <p>Licence Number <u>0000 766 48355</u></p> <p>Check applicable type of propane operations.</p> <p> <input type="checkbox"/> Cylinder <input type="checkbox"/> Motor Fill <input checked="" type="checkbox"/> Filling Plant <input type="checkbox"/> Card/Keylock </p> <p>Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.</p>	<p>For Office Use Only</p> <div style="background-color: black; width: 100px; height: 50px; margin: 0 auto;"></div>
----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name A <u>2156646 Ontario Inc</u>		Ontario Corporation No., if applicable <u>2156646</u>
Operator Name (if different from above) <u>Norwood Crown Ssso gas bar and convenience Store</u>		
Telephone No. <u>7056391616</u>	Fax No. <u>7056391616</u>	E-mail Address <u>norwoodcrown@gmail.com</u>
Street No. B <u>2254</u>		Street Name, Lot / Concession No. <u>County Road 45</u>
Town / City or Township / County <u>Norwood</u>		Province <u>Ontario</u>
		Postal Code <u>K0L 2V0</u>
Mailing address if different from above.		
Street No. C		Street Name, Lot / Concession No. <u>N/A</u>
Town / City or Township / County		Province
		Postal Code

Information on Container Refill Centre or Filling Plant

Location of facility.

Street No. D <u>2254</u>		Street Name, Lot / Concession No. <u>County Road 45</u>	Nearest major intersection <u>County Roads 45 & 42</u>
Town / City or Township / County <u>Norwood</u>		Province <u>Ontario</u>	Postal Code <u>K0L 2V0</u>

Name of Licence Holder <u>2156646 Ontario Inc</u>	
Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). <u>JISU THOMAS</u>	ROT type <u>PPO-3</u>
Municipality (or municipalities if the facility or its hazard distance touches multiple borders) <u>Norwood</u>	



This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder <u>JISU THOMAS</u>	<u>[Signature]</u>	<u>5-11-2011</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>JISU THOMAS</u>	<u>[Signature]</u>	<u>5-11-2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RGMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established. Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.


1999

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	<u>250 psi</u>	<u>797-99</u>
Tank2:	_____	_____
Tank3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 1000 USWG Portable: 2 X 450L Mobile: 1 X 20 LBS



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	<u>JISU THOMAS</u>	
Signature	Official Title	
	<u>OWNER / President</u>	
	Telephone No.	Date (dd-mm-yyyy)
	<u>705-639-1616</u>	<u>5-11-2011</u>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) <i>Casey's propane Inc</i>		For Office Use - Party No.	
Street No. <i>835</i>	Street Name Lot / Concession No. <i>Highway-7 RR#8</i>		
Town / City or Township / Country <i>Peterborough</i>		Province <i>Ontario</i>	Postal Code <i>K9J 6X9</i>
Telephone No. <i>705-742-9198</i>	Fax No. <i>705-742-3542</i>	Contact Name <i>Don Vollerling</i>	
E-mail <i>caseyspro@bellnet.ca</i>			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		For Office Use - Party No.	
Street No.	Street Name Lot / Concession No.		
Town / City or Township / Country <i>N/A</i>		Province	Postal Code
Telephone No.	Fax No.	Contact Name	
E-mail			

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name Lot / Concession No.		
Town / City or Township / Country <i>N/A</i>		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>J IJU THOMAS</i>	Official Title <i>OWNER/PRESIDENT</i>	
Signature <i>[Signature]</i>	Telephone No. <i>705-639-1616</i>	Date (dd-mm-yyyy) <i>5-11-2011</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

10,000 L Regular Gasoline
2000 L Supreme gasoline
10000 L Diesel
600 L Stove oil } All underground Storage tanks.

Description of fire and emergency equipment indicated on facility site map.

6 Fire extinguishers
~~water sprinkler system on kitchen hood (Fire Suppression System) and on the roof~~ ~~sandbags of the building~~

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Kitchen hood is equipped with ~~water~~ Fire Suppression system.

Maintenance and testing schedule for fire protection controls and devices.

As per the law every six months on suppression system and annual inspection for fire extinguishers

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	JISU THOMAS		Official Title	President
Signature			Telephone No.	705-639-1616
			Date (dd-mm-yyyy)	5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name <i>JIJU THOMAS</i>	For Office Use - Party No.	Name <i>JIJU THOMAS</i>	For Office Use - Party No.
Official Title <i>OWNER/President</i>		Official Title <i>President</i>	
Telephone No. <i>705-639-1616</i>	Fax No. <i>705-639-1616</i>	Cell No. <i>705-761-6959</i>	Fax No. <i>705-639-1616</i>
E-mail <i>norwoodcrown@gmail.com</i>		E-mail <i>norwoodcrown@gmail.com</i>	
Role and responsibilities in emergency <i>Call 911 Safety of all personnels first, then safety of the property as detailed</i>		Role and responsibilities in emergency <i>Call 911 Safety of people and property. Act as detailed on attached plan.</i>	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name <i>Suresh</i>	For Office Use - Party No.	Name <i>JIJU THOMAS</i>	For Office Use - Party No.
Official Title <i>Employee</i>		Official Title <i>President</i>	
Telephone No. <i>cell-63-438-6531</i>	Fax No.	Telephone No. <i>705-639-1616</i>	Fax No. <i>705-639-1616</i>
E-mail		E-mail <i>norwoodcrown@gmail.com</i>	
Role and responsibilities in emergency <i>Call 911 Safety of people and safety of property as detailed.</i>		Role and responsibilities in emergency <i>Call 911 Safety of people and safety of property Act as detailed in the attached plan.</i>	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name <i>Chuck Pedersen</i>	For Office Use - Party No.	Name <i>Don Vollerling</i>	For Office Use - Party No.
Official Title <i>fire chief</i>		Official Title	
Telephone No. <i>705-639-5412/5212</i>	Fax No. <i>705-639-5434</i>	Telephone No. <i>1800-252-1526</i>	Fax No. <i>705-742-3542</i>
E-mail <i>epedersen@asphodelnorwood.com</i>		E-mail <i>caseyspro@bellnet.ca</i>	
Role and responsibilities in emergency <i>Incident commander</i>		Role and responsibilities in emergency <i>Support to tackle the emergency situation. Support to use equipments to extinguish the fire.</i>	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name <i>Chris Snetgenger</i>	For Office Use - Party No.	Name <i>Valerie Przybilla</i>	No.
Official Title <i>Deputy Chief</i>		Official Title <i>CAO/Clerk-Treasurer</i>	
Telephone No. <i>705-639-5412</i>	Fax No. <i>705-639-5434</i>	Telephone No. <i>705-639-5343x205</i>	Fax No. <i>705-639-1880</i>
E-mail		E-mail <i>valeriep@asphodelnorwood.com</i>	
Role and responsibilities in emergency <i>Incident commander.</i>		Municipality <i>NORWOOD</i>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>JIJU THOMAS</i>	Official Title <i>President/owner</i>
Signature	Telephone No. <i>705-639-1616</i> / Date (dd-mm-yyyy) <i>5-11-2011</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

- 1) Access to water hydrant (30 meter) on the same property
- 2) Access to town water supply from the building on site.
- 3) Emergency shutoff valve on the wall of the building
- 4) Keep the area clean from all combustible materials.
- 5) Parking of vehicles maximum away from the filling facility
- 6) No vehicles stopped near with engine running, near the propane tanks.
- 7) Daily inspection of the facility at opening and closing times as detailed on the attached sheet.
- 8) Keeping the facility ventilated for 3 min before start filling tanks.
- 9) Keeping away all electronics/cellphones/lighters when going near to the propane filling plant.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	JISU THOMAS		Official Title	President / Owner
Signature			Telephone No.	705-639-1616
			Date (dd-mm-yyyy)	5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 29 April 2008	Print Name of Training Provider: Casey's propane Inc.
	Print Name of Instructor: Dan Vollerling
Training Date (dd-mm-yyyy) 27 May 2009	Print Name of Training Provider: Casey's propane Inc.
	Print Name of Instructor: Dan Vollerling
Training Date (dd-mm-yyyy) 31 May 2011	Print Name of Training Provider: Casey's propane Inc.
	Print Name of Instructor: Dan Vollerling

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy) 29 April 2008	Print Name of Training Provider: Casey's propane
	Print Name of Instructor: Dan Vollerling
Training Date (dd-mm-yyyy) 27 May 2009	Print Name of Training Provider: Casey's propane
	Print Name of Instructor: Dan Vollerling
Training Date (dd-mm-yyyy) 31 May 2011	Print Name of Training Provider: Norwood Crown ESO
	Print Name of Instructor: JIJU THOMAS

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 11 April 2011	Print Name of Training Provider: Larry O'Donnel # 155250 (TSSA)
	Print Name of Instructor: Larry O'Donnel # 155250 (TSSA)
Training Date (dd-mm-yyyy) 16 June 2011	Print Name of Training Provider: Larry O'Donnel # 155250 (TSSA)
	Print Name of Instructor: Larry O'Donnel # 155250 (TSSA)
Training Date (dd-mm-yyyy) 20 July 2011	Print Name of Training Provider: Larry O'Donnel # 155250 (TSSA)
	Print Name of Instructor: Larry O'Donnel # 155250 (TSSA)

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JIJU THOMAS	Official Title President
Signature 	Telephone No. 705-639-1616
	Date (dd-mm-yyyy) 5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 2 Jan 2012	Print Name of Training Provider: Casey's propane
	Print Name of Instructor: Dan Vellering
Target Date (dd-mm-yyyy) 30 April 2012	Print Name of Training Provider: do Same as above
	Print Name of Instructor: do Same as above
Target Date (dd-mm-yyyy) 31 Dec 2012	Print Name of Training Provider: do Same as above
	Print Name of Instructor: do Same as above.

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 2 Jan 2012	Print Name of Training Provider:
	Print Name of Instructor: JIJU THOMAS
Target Date (dd-mm-yyyy) 30 April 2012	Print Name of Training Provider: do Same as above
	Print Name of Instructor: do Same as above
Target Date (dd-mm-yyyy) 31 Dec 2012	Print Name of Training Provider: do Same as above
	Print Name of Instructor: do Same as above.

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) 3 Jan 2012	Print Name of Training Provider: Larry O'Donnel TSSA# 155250
	Print Name of Instructor: do Same as above
Target Date (dd-mm-yyyy) 31 May 2012	Print Name of Training Provider: do Same as above
	Print Name of Instructor: do Same as above
Target Date (dd-mm-yyyy) 31 Dec 2012	Print Name of Training Provider: do Same as above
	Print Name of Instructor: do Same as above.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) JIJU THOMAS	Official Title President
Signature 	Telephone No. 705-639-1616
	Date (dd-mm-yyyy) 5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).

As per the attached plan: Person who notices the fire or leak at the propane will shout - Fire fire fire. This applies to the the fire at the site also.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

As detailed in the Risk and Safety management plan, All persons will be evacuated to the safe meeting place at the Birch and Spruce Street junction. The warning will be issued by the first person working at the site first by the

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911)

(First Safety of the people will be taken. Then the property) ~~Then call~~
Call 911. Call the supplier. Exercise the evacuation plan.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

Access to the property is available at all times to the fire dept. The doors of the filling station is locked regularly with a pad lock

Describe how the licence holder will ensure continual flow of updated information to authorities.

With regular review of our plans as required, and any changes will be notified to the fire dept and to TSSA.

How long will it take the facility liaison person to respond to the site.

Immediately during working hours (5am - 10pm every day) and within 5 minutes from the place of residence.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)

JIM THOMAS

Official Title

President & Owner

Signature

Telephone No.

705-761-6959

Date (dd-mm-yyyy)

5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (R3MP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)		<u>34 meters</u>
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)		<u>N/A</u>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	JIM THOMAS		Official Title	President
Signature			Telephone No.	1-705-639-1616
			Date (dd-mm-yyyy)	5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes No

If not, please explain (e.g., no fire services).

N/A

Fire services comments, if any:

Please see attached comments sheet from the Fire Service

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The Licence holder will respond to the Local Fire Services comments by:

(dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name <i>Chuck Pedersen</i>	<i>Chuck Pedersen</i>	<i>17/11/2011</i>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>JILL THOMAS</i>	Official Title <i>President</i>
Signature <i>J. Thomas</i>	Telephone No. <i>705-639-1616</i> Date (dd-mm-yyyy) <i>5-11-2011</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below .

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy)	Capacity of single largest propane storage vessel (USWG) <i>1000 USWG</i>
Tank setback coordinates. Indicate placement on the map.	
Front: <i>47 meters</i>	Right side property line: <i>71 meters</i>
Rear: <i>4.3 meters</i>	Left side property line: <i>10 meters</i>
GPS coordinates of single largest vessel: _____	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <i>JITH Thomas</i>	Official Title <i>President</i>	
Signature 	Telephone No. <i>705-639-1616</i>	Date (dd-mm-yyyy) <i>5-11-2011</i>



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

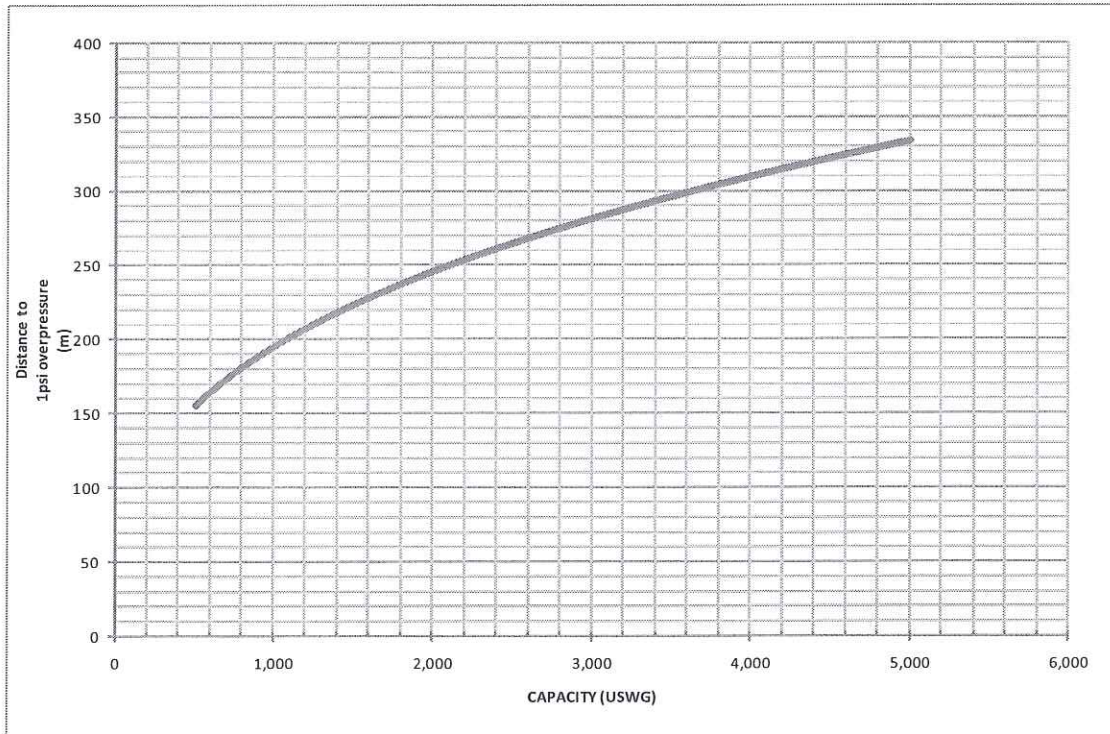

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	JIM THOMAS		Official Title	President
Signature			Telephone No.	705-639-1616
			Date (dd-mm-yyyy)	5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772


Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	<input checked="" type="checkbox"/>				_____ m
			<input checked="" type="checkbox"/>	32	<u>10.65</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	<input checked="" type="checkbox"/>				_____ m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____	<input checked="" type="checkbox"/>				_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>Maple View Retirement Centre</u> Address: <u>2281 County Road 45</u> City: <u>Norwood</u> Province <u>Ontario</u> Postal Code <u>K0L 2V0</u>		<input checked="" type="checkbox"/>		1	<u>200</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: <u>Asphodel-Norwood Fire Dept (Fire Station)</u> Address: <u>27 Alma Street, Box # 29</u> City: <u>Norwood</u> Province <u>Ontario</u> Postal Code <u>K0L 2V0</u>			<input checked="" type="checkbox"/>	2	<u>600</u> m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	JIJU THOMAS		Official Title	President
Signature			Telephone No.	705-639-1616
			Date (dd-mm-yyyy)	5-11-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9	2	247.8
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8	1	5.8
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
Total Tank Capacity		

Total Cylinder Capacity	
Total Tank Capacity	
Total Portable Capacity	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	JISU THOMAS	Official Title	President
Signature		Telephone No.	705-639-1616
		Date (dd-mm-yyyy)	5-11-2011

Fire Service Comments on the RSMP for 2254 County Rd. 45

1. The Asphodel-Norwood Fire Department is trained to awareness level for HAZMAT response.
2. The hydrant on site would be too close for an actual fire impeding the propane filling station; therefore an alternative hydrant located at 2272 County Rd. 45 would likely be used to protect the safety of the firefighter.
3. Page 4 of RSMP should also include the operation of the propane isolation valve.
4. Page 6 has some items listed that would be considered part of the minimum requirements/standards, not exceeding those.
5. Page 9 should include the door-to-door notification as mentioned in the provided policy & procedures document.
6. Page 9 – It should be noted that 911 call information must be specific when involving a concern with the propane filling station for the protection of the responders.
7. The map indicates 'Open Area' as part of the 'Old Age Home'. In fact the indicated 'open area' address is 2253 County Rd. 45 and is a residential single-family dwelling; furthermore residential numbers on page 14 should address this additional residential property.
8. The map also shows two field areas south of Birch and South of County Rd. 42 that belong to residential farms and should be included in the residential count and notification
9. There is an approved sub-division extension of Maple Ave traveling East from Spruce Drive indicated as Part 1 on the map; review and adjustment of the plan should incorporate this once occupancy is given.
10. There is a Hydro One sub-station located just outside the 195m buffer areas at 25 Birch Street. Due to this critical infrastructure and potential ignition source the plan should indicate that Hydro-One also be notified

Fire Chief




C. Pedersen

NOV. 17/2011 C.P.



NORWOOD CROWN ESSO
2254 COUNTY ROAD 25
NORWOOD K0L 2V0

COUNTY ROAD 45

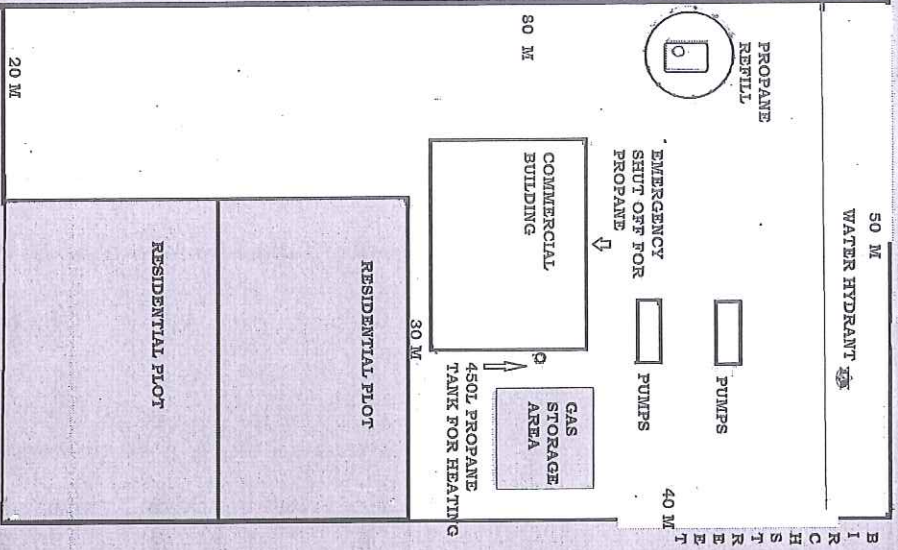

O U N T A R I O

B I R C H S T R E E T

NORWOOD CROWN ESSO GAS BAR
AND CONVENIENCE STORE

2254 COUNTY ROAD 45

NORWOOD, ONTARIO

K0L 2V0

SITE MAP

DISTANCES FROM THE PROpane

REFILL PLANT

1. TO THE BUILDING ON SITE = 12 METERS
 2. TO THE LEFT PROPERTY LINE=10 METERS (COUNTY ROAD 45)
 3. TO THE RIGHT PROPERTY LINE = 71 METERS
 4. TO THE REAR PROPERTY LINE = 4.3 METERS
 5. TO THE FRONT PROPERTY LINE = 47 METERS (BIRCH STREET)
 6. TO THE FIRE HYDRANT = 35 METERS
 7. TO THE FUEL NOZZLES = 25 M
- VOLUME OF LIQUID FUEL(GAS AND DIESEL)
 REGULAR GAS 22700L
 SUPREME GAS 45400 L
 DIESEL 22700 L
 STOVE OIL 2273 L

LOCATION OF FIRE EQUIPMENTS
 FIRE EXTINGUISHER IN PROpane FILLING ROOM -1
 FIRE EXTINGUISHERS IN THE BUILDING -2
 FIRE EXTINGUISHERS AT FUEL PUMPS -2
 KITCHEN HOOD IN THE BUILDING IS EQUIPPED WITH
 FIRE SUPPRESSION SYSTEM


SIZE OF THE BUILDING = 12 M X20.4 M

2254 County Rd 45 - Propane Station

NORWOOD, ONTARIO
K0L-2V0



SCALE 1 : 2,750



GPS Visualizer

- About GPSTV
- DRAW A MAP
- DRAW A PROFILE
- CONVERT A FILE
- Atlas: Share a map
- Geocode an address
- Look up elevations
- Google Earth overlays
- Calculators
- GPSTbabel
- Help/FAQ
- Examples
- Partner sites:
- GlobalMotion.com
- EveryTrail.com
- EveryTrail Guides



GPS Visualizer's Quick Geocoder

Find the latitude and longitude of an address

This page returns coordinates provided by the Yahoo! and Google Geocoding APIs. Both services only allow each Web site and/or IP address a limited number of queries per day; please don't abuse it.

If you disagree with the coordinates shown here, you'll have to register your complaints with [Yahoo](#) or [Google](#). (If the results you get are close but not exact, you can move the map around until the center crosshair is over the proper location, then read the coordinates from the "Center:" box in the lower-left corner of the map.)


To geocode many locations at once, see [GPS Visualizer's Easy Batch Geocoder](#).

Enter an address or location: Source:

You entered: **2254 county road 45,norwood ontario**

The Google geocoder found:

2254 County Road 45, Norwood, ON K0L 2V0, Canada	
street address: 2254 County Road 45	
ZIP/postal code: K0L 2V0	
city: Norwood	
state/province: ON	
country: Canada	
latitude, longitude: 44.374005, -77.9740708	
44.374005 -77.9740708	
N44° 22.4403', W077° 58.4442'	(precision: address)

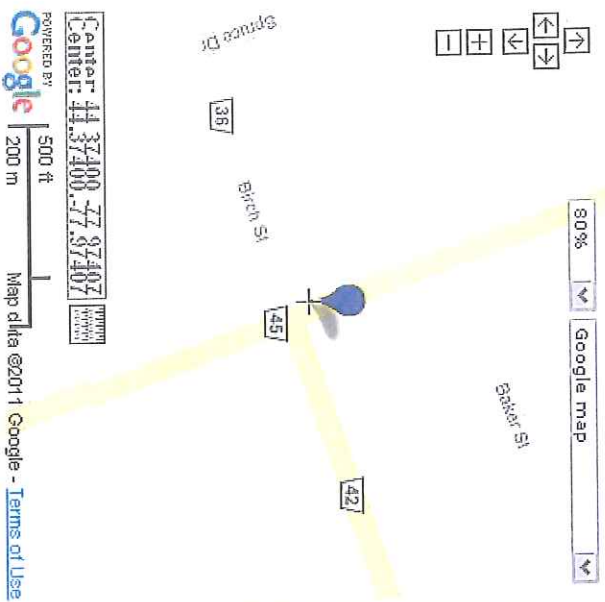

[Return to the main GPS Visualizer Page](#)

Every Trail Guides

Print or download travel guides to your phone or GPS. Skyline to the Sea Trail • Hiking the Grand Canyon Rim to Rim • Half Dome • The Boston Freedom Trail • Upper Yosemite Falls Hike • Lands End, San Francisco • Angel Island State Park • Carcass Trail Loop in Marin County • Coyote Creek Loop at Henry Co. State Park • Half Moon Bay Coastal Trail • Bay Area Wildflower Hikes • Bay Area Scenic Drives • Sunset Wilderness • Stanford Dish Hike • Grand Canyon Kalbar to Bright Angel Trail • The Grand Canyon Rim Trail • Best Bay Area Backpacking • The High Sierra Trail • Best Bay Area Day Hikes • Great Hikes in the Grand Canyon • Queen's Garden Trail, Bryce Canyon Utah • Barry Creek Falls Loop at Big Basin Redwoods State Park • and more...